


Cable Gland Selection Guide

Selection Chart – Certifications

Type	Series	Material	Non-Armored Cables	Armored Cables			
				Wire	Braid	Tape	
Neoprene Seal	"e" or "i"	Ex e	Polyamide	Yes			
Elastomer Seal	"d" and "e"	A2F	Brass, fully nickel plated / Stainless Steel	Yes			
		E1FX	Brass, fully nickel plated		Yes	Yes	
		E1FW	Brass, fully nickel plated		Yes		
		E1FU	Brass, fully nickel plated		Yes	Yes	Yes
		T3	Brass, fully nickel plated		Yes	Yes	Yes
		TE1FU	Stainless Steel		Yes	Yes	Yes
Compound Seal	"d" and "e"	PX (PXSS2K)	Brass, fully nickel plated	Yes			
		PX2K	Brass, fully nickel plated		Yes	Yes	Yes
Liquid resin	"d" and "e"	PXSS2K-REX	Brass, fully nickel plated	Yes			
		PX2K-REX	Brass, fully nickel plated		Yes	Yes	Yes

Selection Guide

Selection of cable entry for Ex d flameproof enclosure according to electrical installations IEC 60079-14/ABNT NBR IEC 60079-14.

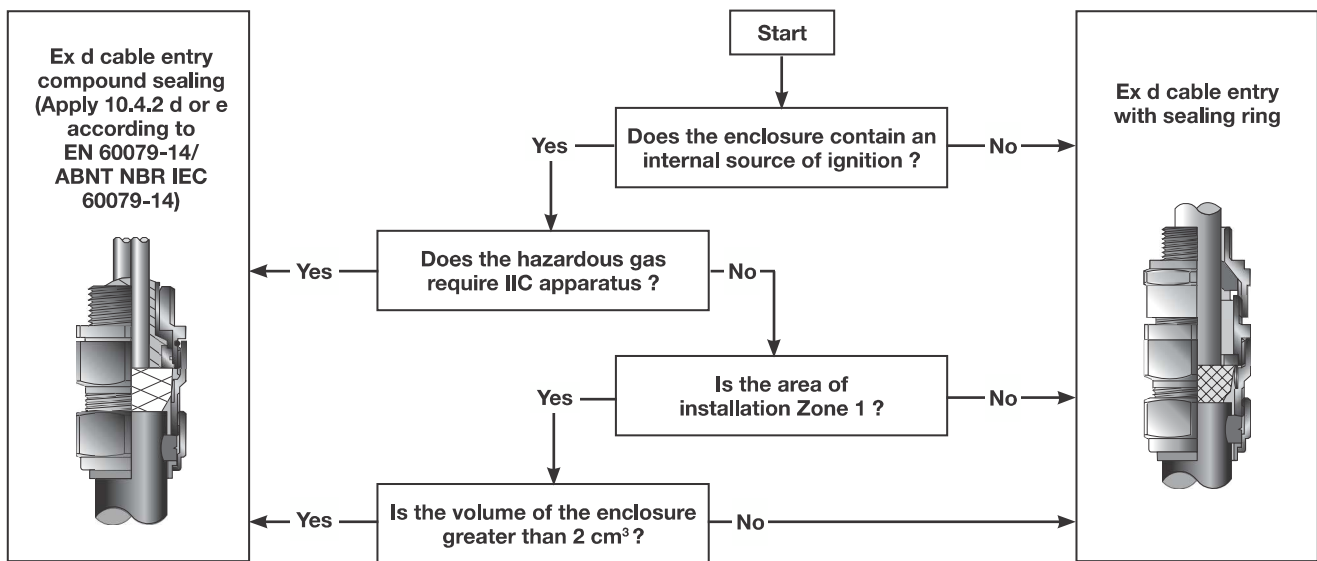

Note: Cable must be substantially compact and circular with an extruding bedding, and if any filters are used they are Non-Hygroscopic.